



Reduce Your Risk!®

Independent Slip Testing Services


AUSTRALIA | NEW ZEALAND | GLOBAL

Independent Slip Testing Services

+61 (0) 411 600 733 www.sliptesting.com.au | +64 (0) 279 735 266 www.sliptesting.co.nz

Report Prepared for: All Purpose Coatings Client Address: 16 Hawkins Crescent, Bundamba QLD 4304 Australia
 Property Tested: 16 Hawkins Crescent, Bundamba Date of Test: 18-06-2024 Program #: 4004 Page: 13 of 17

Test Location	Surface Type	Surface Coating	Surface Conditions	Slider Conditioning	British Pendulum Number (BPN)	Slip Resistance Value & Slope Correction Value	TEST RESULTS (Slider96)	
Test Area 12. Ultra Flake Small- Grip 25 Finish	epoxy flake	Mist S Neutral Grey coating	environment: internal (dry area) slope: <1.5 degrees surface: rough test direction: anticipated pedestrian travel other observations: n/a	P400	55	(SRV)	Mean BPN result after adjustments	Classification
				83	54	55		
				lapping	57	(SCV)	55	P5
					64	56		

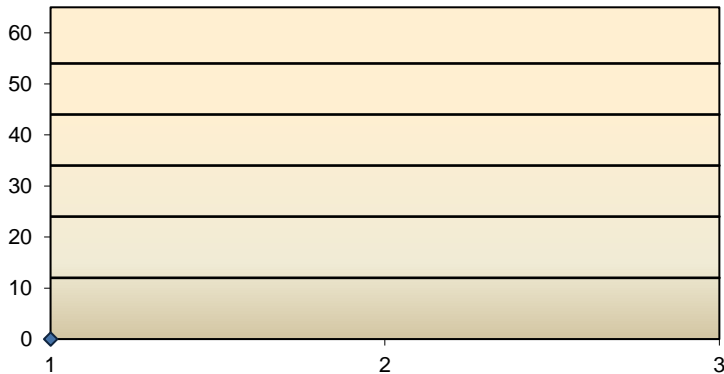

COMMENTS:

Temp: 24 deg.C
 Weather: Internal- Non Air conditioned
 Surface Cleaning: Tested as found
 Testing Instrument W12- Serial #: WM007
 Testing Technician: C.Rezuk
 ^ An individual result both below the result classification and below the mean result minus 20% shall be considered of lower classification

Reported Uncertainty for testing device: 3.0 BPN
ISTS GLOBAL HEADQUARTERS:
 124 Hindes Street Lota QLD 4179 Australia

DISCLAIMER: ISTS accepts no civil liability or responsibility for any actions whatsoever that may arise as a result of the tests and the publication and issue of this test report. The test report is intended for viewing purposes solely for the named recipient identified above. The slip test report remains the property of ISTS. This report contains privileged and confidential information. The unauthorised reproduction of this report is prohibited.

Accredited for compliance with ISO/IEC 17025 testing and calibration. NATA is a signatory to the APLAC mutual recognition arrangement for the mutual recognition of the equivalence of testing, calibration and inspection reports.

Signature: Mick Walton

Accreditation No. 14967